





BRY-AIR, INC.  
 ROUTE 37 WEST  
 SUNBURY, OHIO 43074  
 TEL (740) 965-2974  
 FAX (740) 965-5470  
 E-MAIL: bryair@bry-air.com

## ™ VFB-200 DEHUMIDIFIER

SPECIFICATIONS	VFB-200
Process SCFM	20,000
Reactivation SCFM	6666
Process Ext. Static (inches w.c.)	1.5
Reactivation Ext. Static (inches w.c.)	0.75
Process motor H.P.	20
Reactivation motor H.P.	10
Bed motor H.P.	1/12
Reactivation Heat Req'd - MBH	1440
Control Load - KVA @ 120 V	0.75
Approximate weight - lbs.	6600

### UNIT LENGTH TABLE

React. Heat Source	Construction			
	Std. Indoor 30% Eff. Inlet Filters	Indoor High Eff. Filters	Outdoor 30% Eff. Inlet Filters	Outdoor High Eff. Filters
Electric	14'-7"	14'-7"	14'-7"	14'-9"
Gas	14'-7"	14'-7"	14'-7"	14'-9"
Steam	15'-7"	15'-7"	15'-7"	15'-9"

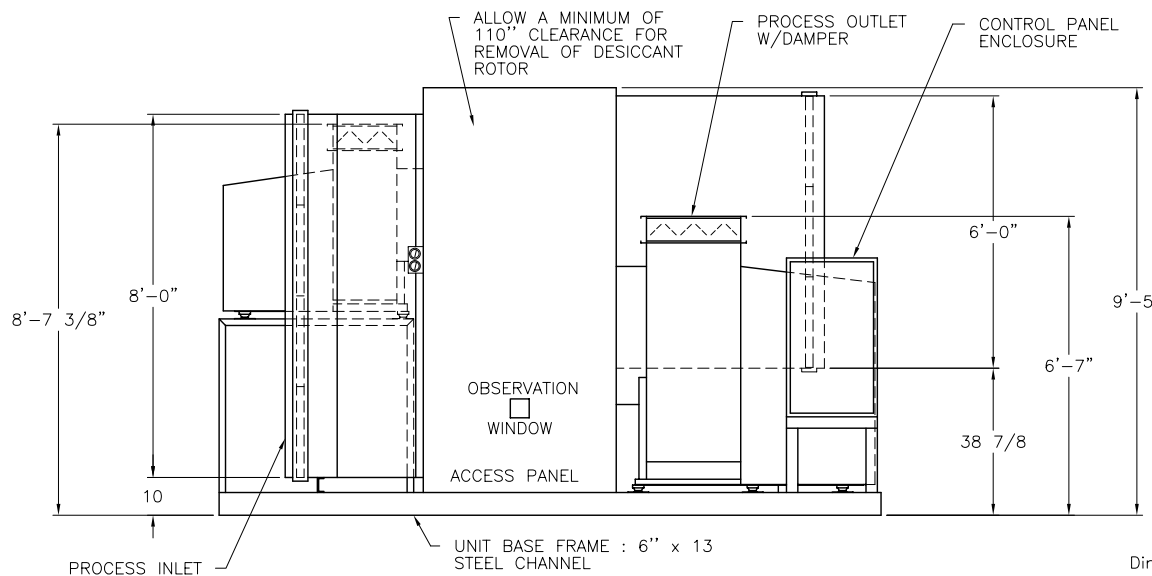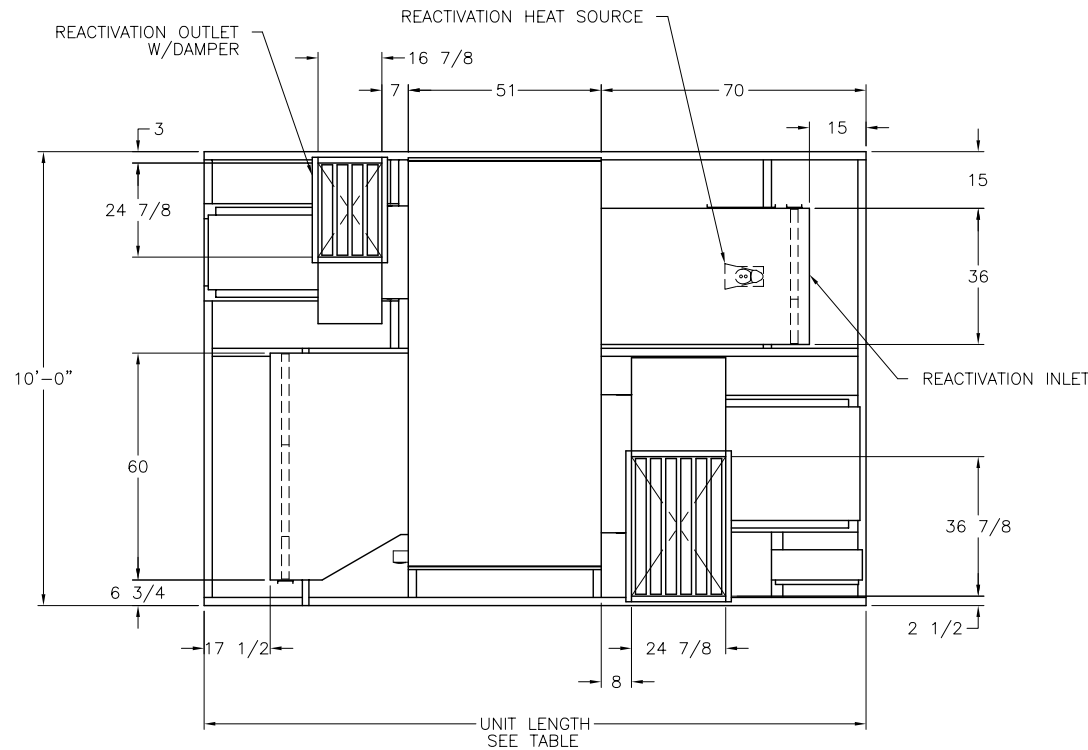

#### NOTES:

1. For outdoor construction the reactivation fan is rotated to a horizontal discharge and a rain hood is added.
2. Supply voltage must be specified.
3. Electrical components are mounted in a drip proof enclosure.
4. Unless otherwise noted, provide 25" clearance around the entire unit and 40" clearance in front of the control panel enclosure.
5. All dimensions are in inches and are subject to change without notice.
6. Specifications subject to change without notice.

This is not a certified drawing.  
 Dimensions shown are for standard gas indoor construction.  
 Contact factory for certified dimensional drawings.

BA-793-2  
 11/21/03