



Ceiling mount installation

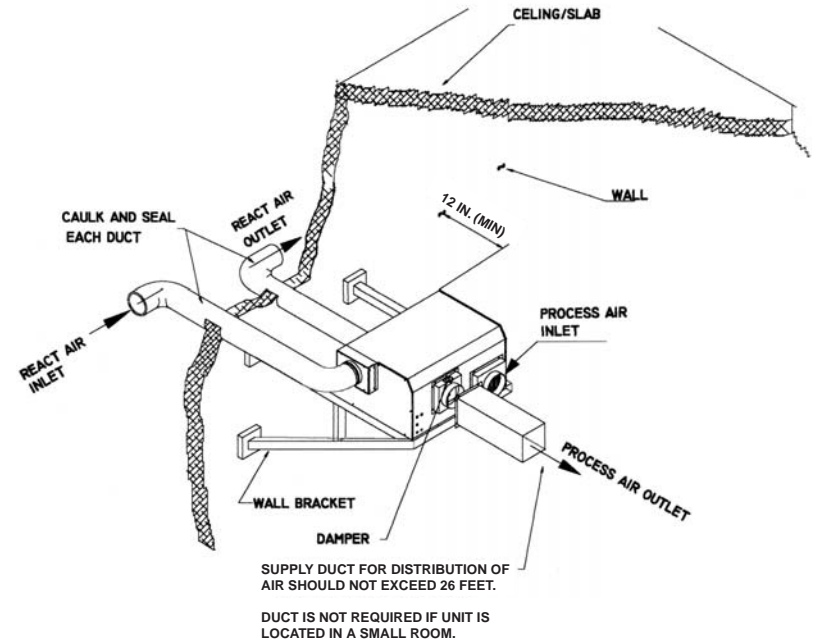

Wall mount installation

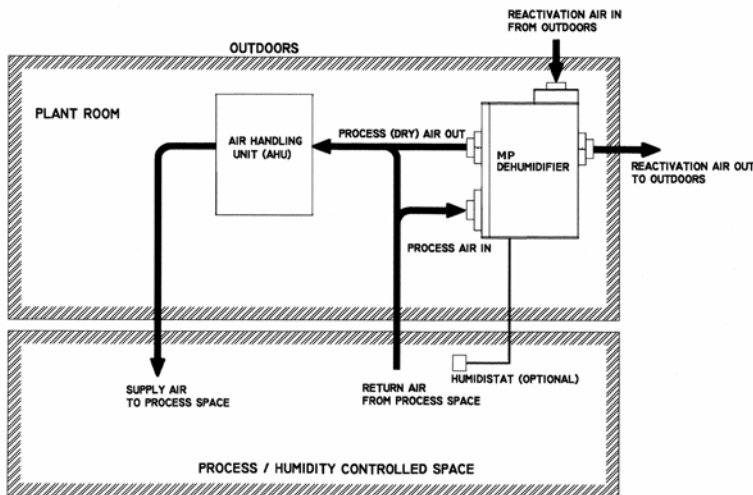

Installation with air handling unit

When installed like the illustration shown to the left, Bry-Air suggests that for more consistent conditions, the cooling fan and the dehumidifier fan should be wired for continuous operation.

MiniPAC[®]
TYPICAL
INSTALLATION



Total Environmental
 Conditioning Solutions™

© and ™ Trademarks of Bry-Air (Asia) Pvt. Ltd.

Bry-Air, Inc.
 10793 St. Rt. 37 W Sunbury,
 Ohio 43074 Phone:
 740-965-2974 Toll Free:
 877-427-9247
 Fax: 740-965-5470